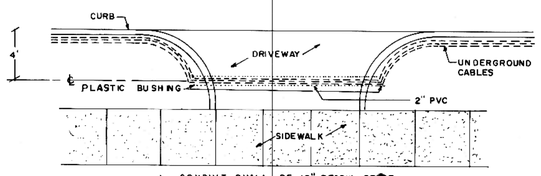

1. CONDUIT SHALL BE 18" BELOW GRADE AND SLOPED 3" FOR DRAINAGE.
2. CONDUIT SHALL EXTEND 6" BEYOND DRIVEWAY AT BOTH ENDS.
3. PROVIDE 9" LOOP IN CABLES AT EACH CONDUIT END.

DRIVEWAY CROSSUNDER DETAIL

NO SCALE

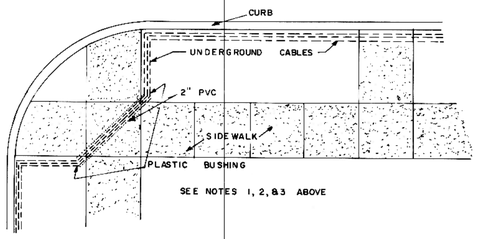

SEE NOTES 1, 2, & 3 ABOVE

SIDEWALK CROSSUNDER DETAIL

NO SCALE

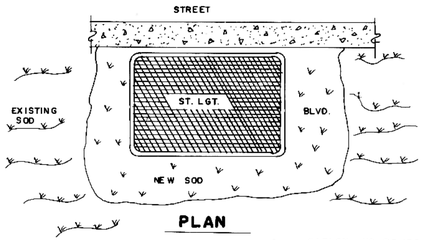

PLAN

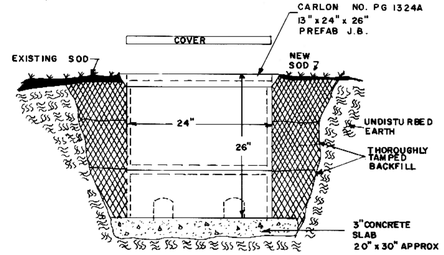

ELEVATION

J. B. DETAILS

TYPICAL

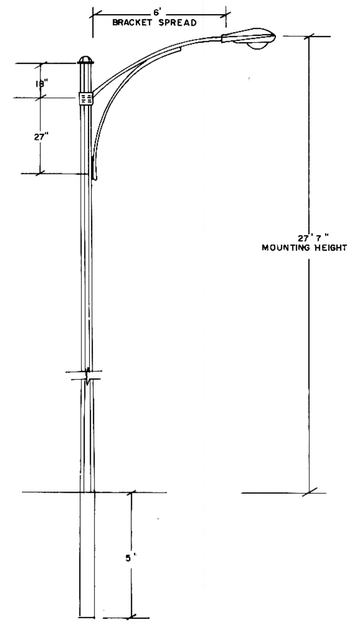

TYPE B & BI

NO SCALE

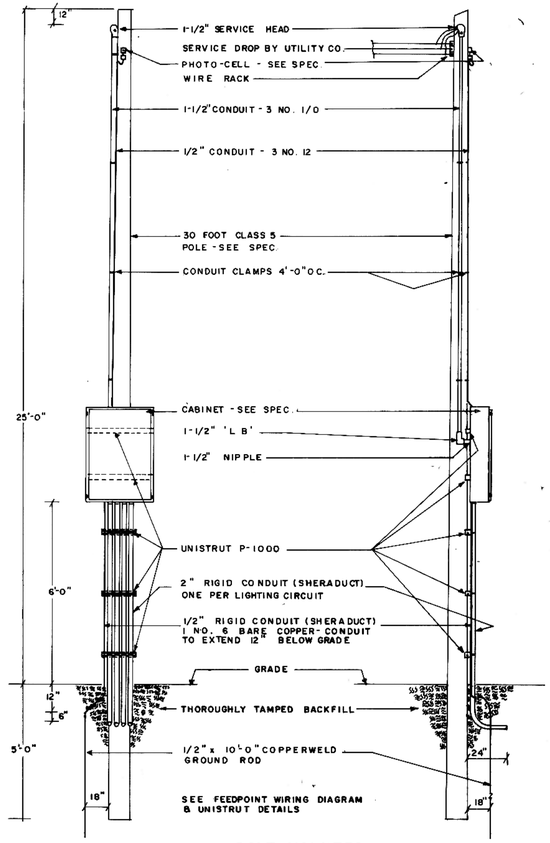

FRONT — POLE MOUNTED — SIDE

FEEDPOINT ELEVATIONS

NO SCALE

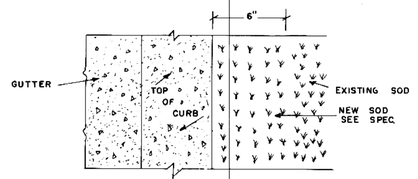

PLAN

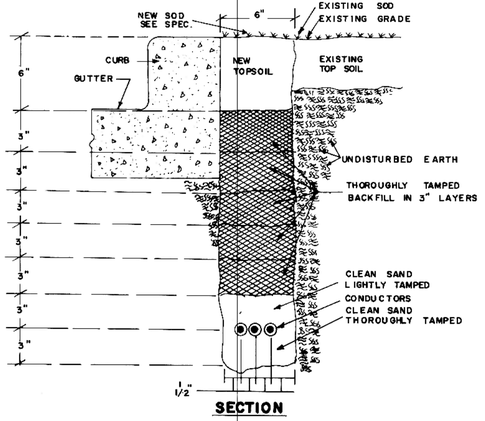

SECTION

UNDERGROUND CABLE DETAILS

NO SCALE

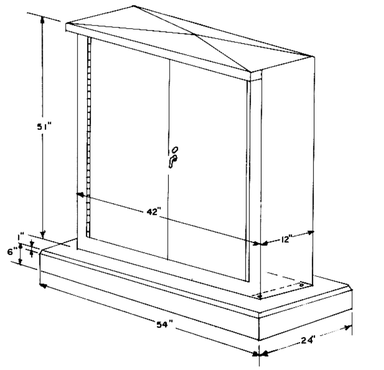

PAD MOUNTED FEEDPOINT DETAILS

TYPICAL CONDITION - SEE SPEC

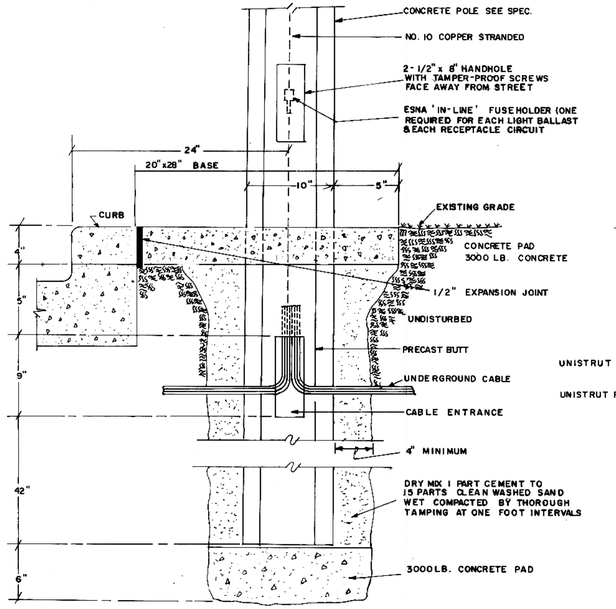

TYPE B&BI BASE DETAIL

NO SCALE

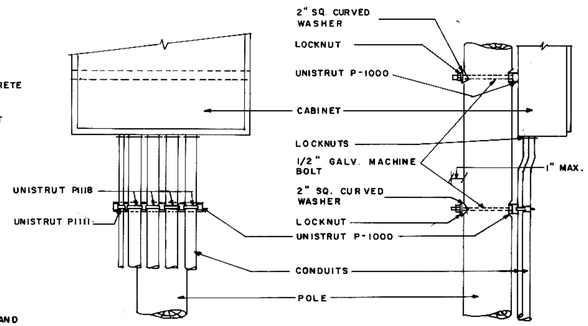

PROVIDE UNISTRUT P-1280 END CAPS ON ALL UNISTRUT CHANNEL

FRONT — SIDE

UNISTRUT DETAILS

NO SCALE

SCHMIT, SMITH & RUSH
CONSULTING ENGINEERS
MINOT NORTH DAKOTA